


Contact Name:  
Date:

Site Name/Number:


Site Address:



**Rung Diameter**

All rungs shall have a minimum diameter of 3/4" for metal ladders.


Compliant     Non-Compliant



**Distance Between Rungs**

The distance between rungs, cleats and steps are spaced not less than 10 inches and not more than 14 inches and shall be uniform throughout the length of the ladder.


Compliant     Non-Compliant



**Distance Between Ladder Rails**

The minimum clear length of rungs or cleats shall be 16 inches.


Compliant     Non-Compliant



**Gripping Surfaces Free of Sharp Edges**

Side rails that might be used as climbing aids shall be of such cross sections as to afford adequate gripping surface without sharp edges, splinters, or burrs.


Compliant     Non-Compliant

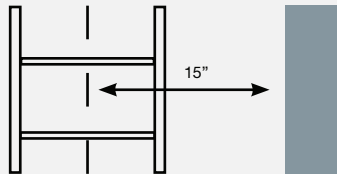

**Clear Width to the Vertical Center Line of the Fixed Ladder**

A clear width of at least 15" shall be provided each way from the centerline of the ladder in the climbing space, except when cages or wells are necessary.

Compliant     Non-Compliant



**Distance on the Climbing Side from Rung to Nearest Object**

The perpendicular distance from the centerline of the rungs to the nearest permanent object on the climbing side of ladder...30" for a pitch of 90°.


Compliant     Non-Compliant



**Permitted Clearance Behind the Fixed Ladder**

The distance from the centerline of rungs, cleats or steps to the nearest permanent object in the back of the ladder shall not be less than 7".


Compliant     Non-Compliant



**Step-Across Distance Between Fixed Ladder Rung and Platform or Landing**

The step-across distance from the nearest edge of ladder to the nearest edge of equipment or structure shall not be more than 12" or less than 7".


Compliant     Non-Compliant

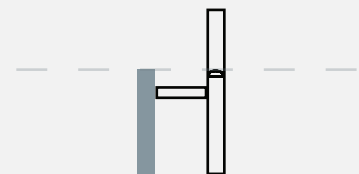

**Top Rung of Ladder Flush with Landing, Platform or Parapet**

One rung of any section of ladder shall be located at the level of landing laterally served by the ladder.


Compliant     Non-Compliant



**Height and Width of Ladder Extension Rails**

A - Side rails shall extend 3.5' above walking/working surface.  
B - Min. clearance of 24" and Max. 30".  
When a ladder safety is provided the clearance cannot exceed 36".


Compliant     Non-Compliant



**Preferred Pitch of Fixed Ladders**

The preferred pitch of fixed ladders shall be considered to come in the range of 75° and 90° with the horizontal.

Compliant     Non-Compliant



**Fall Protection on Fixed Ladders**

Any fixed ladder accessing heights 24' and greater must be equipped with a ladder safety device. As of Nov. 19, 2018 cages are no longer considered a form of fall protection on newly installed ladders.

Compliant     Non-Compliant